


APP'L	DATE	LVL	REVISION
	4-1-97	A	ECN:NO765

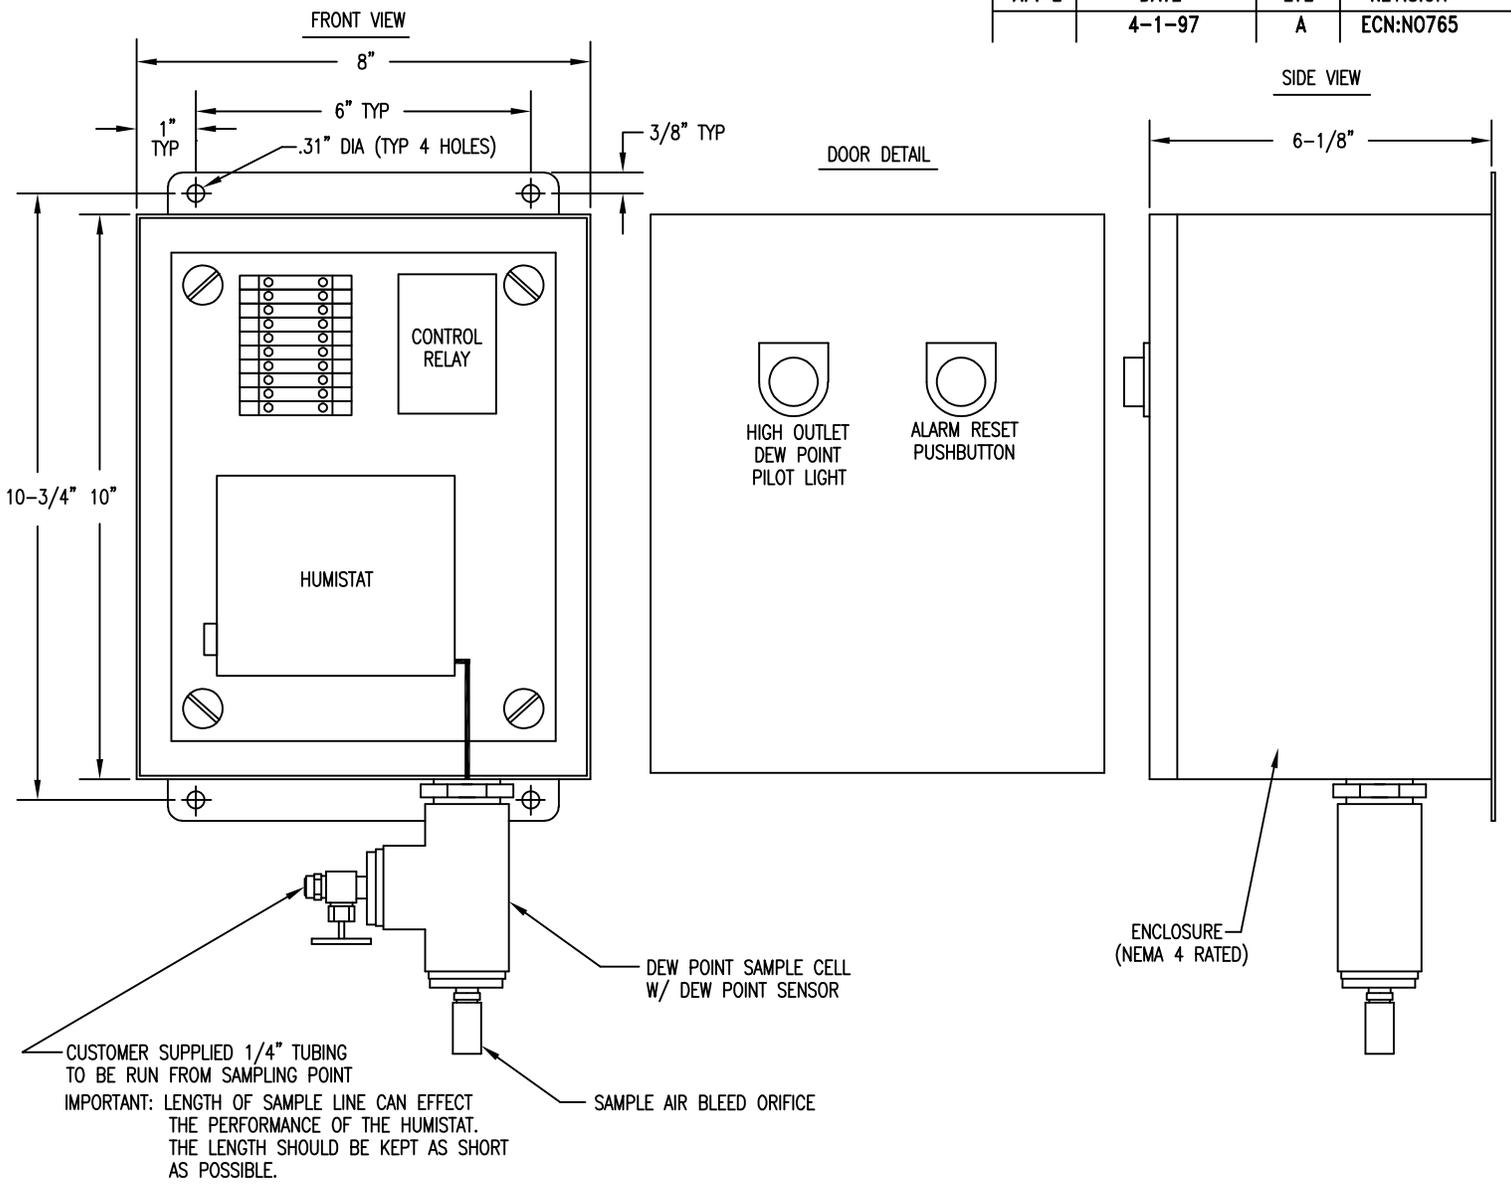

INSTALLATION NOTES:

- 1) UNIT MUST BE INSTALLED ON A SOLID SURFACE IN A SAFE LOCATION FREE FROM POSSIBLE DAMAGE.
- 2) CUSTOMER MUST SUPPLY AND INSTALL ALL INCOMING POWER CONNECTIONS.
- 3) CUSTOMER MUST SUPPLY AND INSTALL SAMPLE AIR SUPPLY LINE.
- 4) ALL ALARM CONNECTIONS AND/OR APPLICATIONS ARE TO BE IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION AND OPERATION INSTRUCTIONS.

HUMISTAT SPECIFICATIONS:

RANGE OF CONTROL: NOMINAL 4% TO 98% RH (GOVERNED BY SENSOR AND SET-PLUG)
 CONTROL MODE: SPDT RELAY, 5 A, NON-INDUCTIVE
 INPUT POWER: 115 VAC, 50-60 HZ

This drawing is the property of **VAN AIR SYSTEMS INC** and is subject to return upon request. It shall not be copied or duplicated in any manner and shall not be submitted to outside parties for examination without the consent of Van Air Systems Inc. It shall be used for reference to work under contract or proposals submitted by Van Air Systems Inc. only.

DEW POINT (LIGHT & CONTACT) ASSEMBLY PART NUMBER 46-2064

DRWN BY: JMR	DATE: 6-25-91	DRWG No. SD-12735	REV A
CHECKED:	SCALE: NONE		

APPL: **VAN AIR SYSTEMS INC**

Lake City, PA 16423 (814)774-2631 Fax: 814/774-3482 Telex: 91-4548